



NOTES:

1. IN REMOVING EXISTING LIGHTING FIXTURES, THE CONTRACTOR SHALL BE RESPONSIBLE FOR RELOCATING AND/OR REPAIRING EXISTING WIRING AND CONDUIT TO MAINTAIN THE EXISTING SYSTEM AS REQUIRED.
2. Junction Box in all connections to automatic system devices as required.

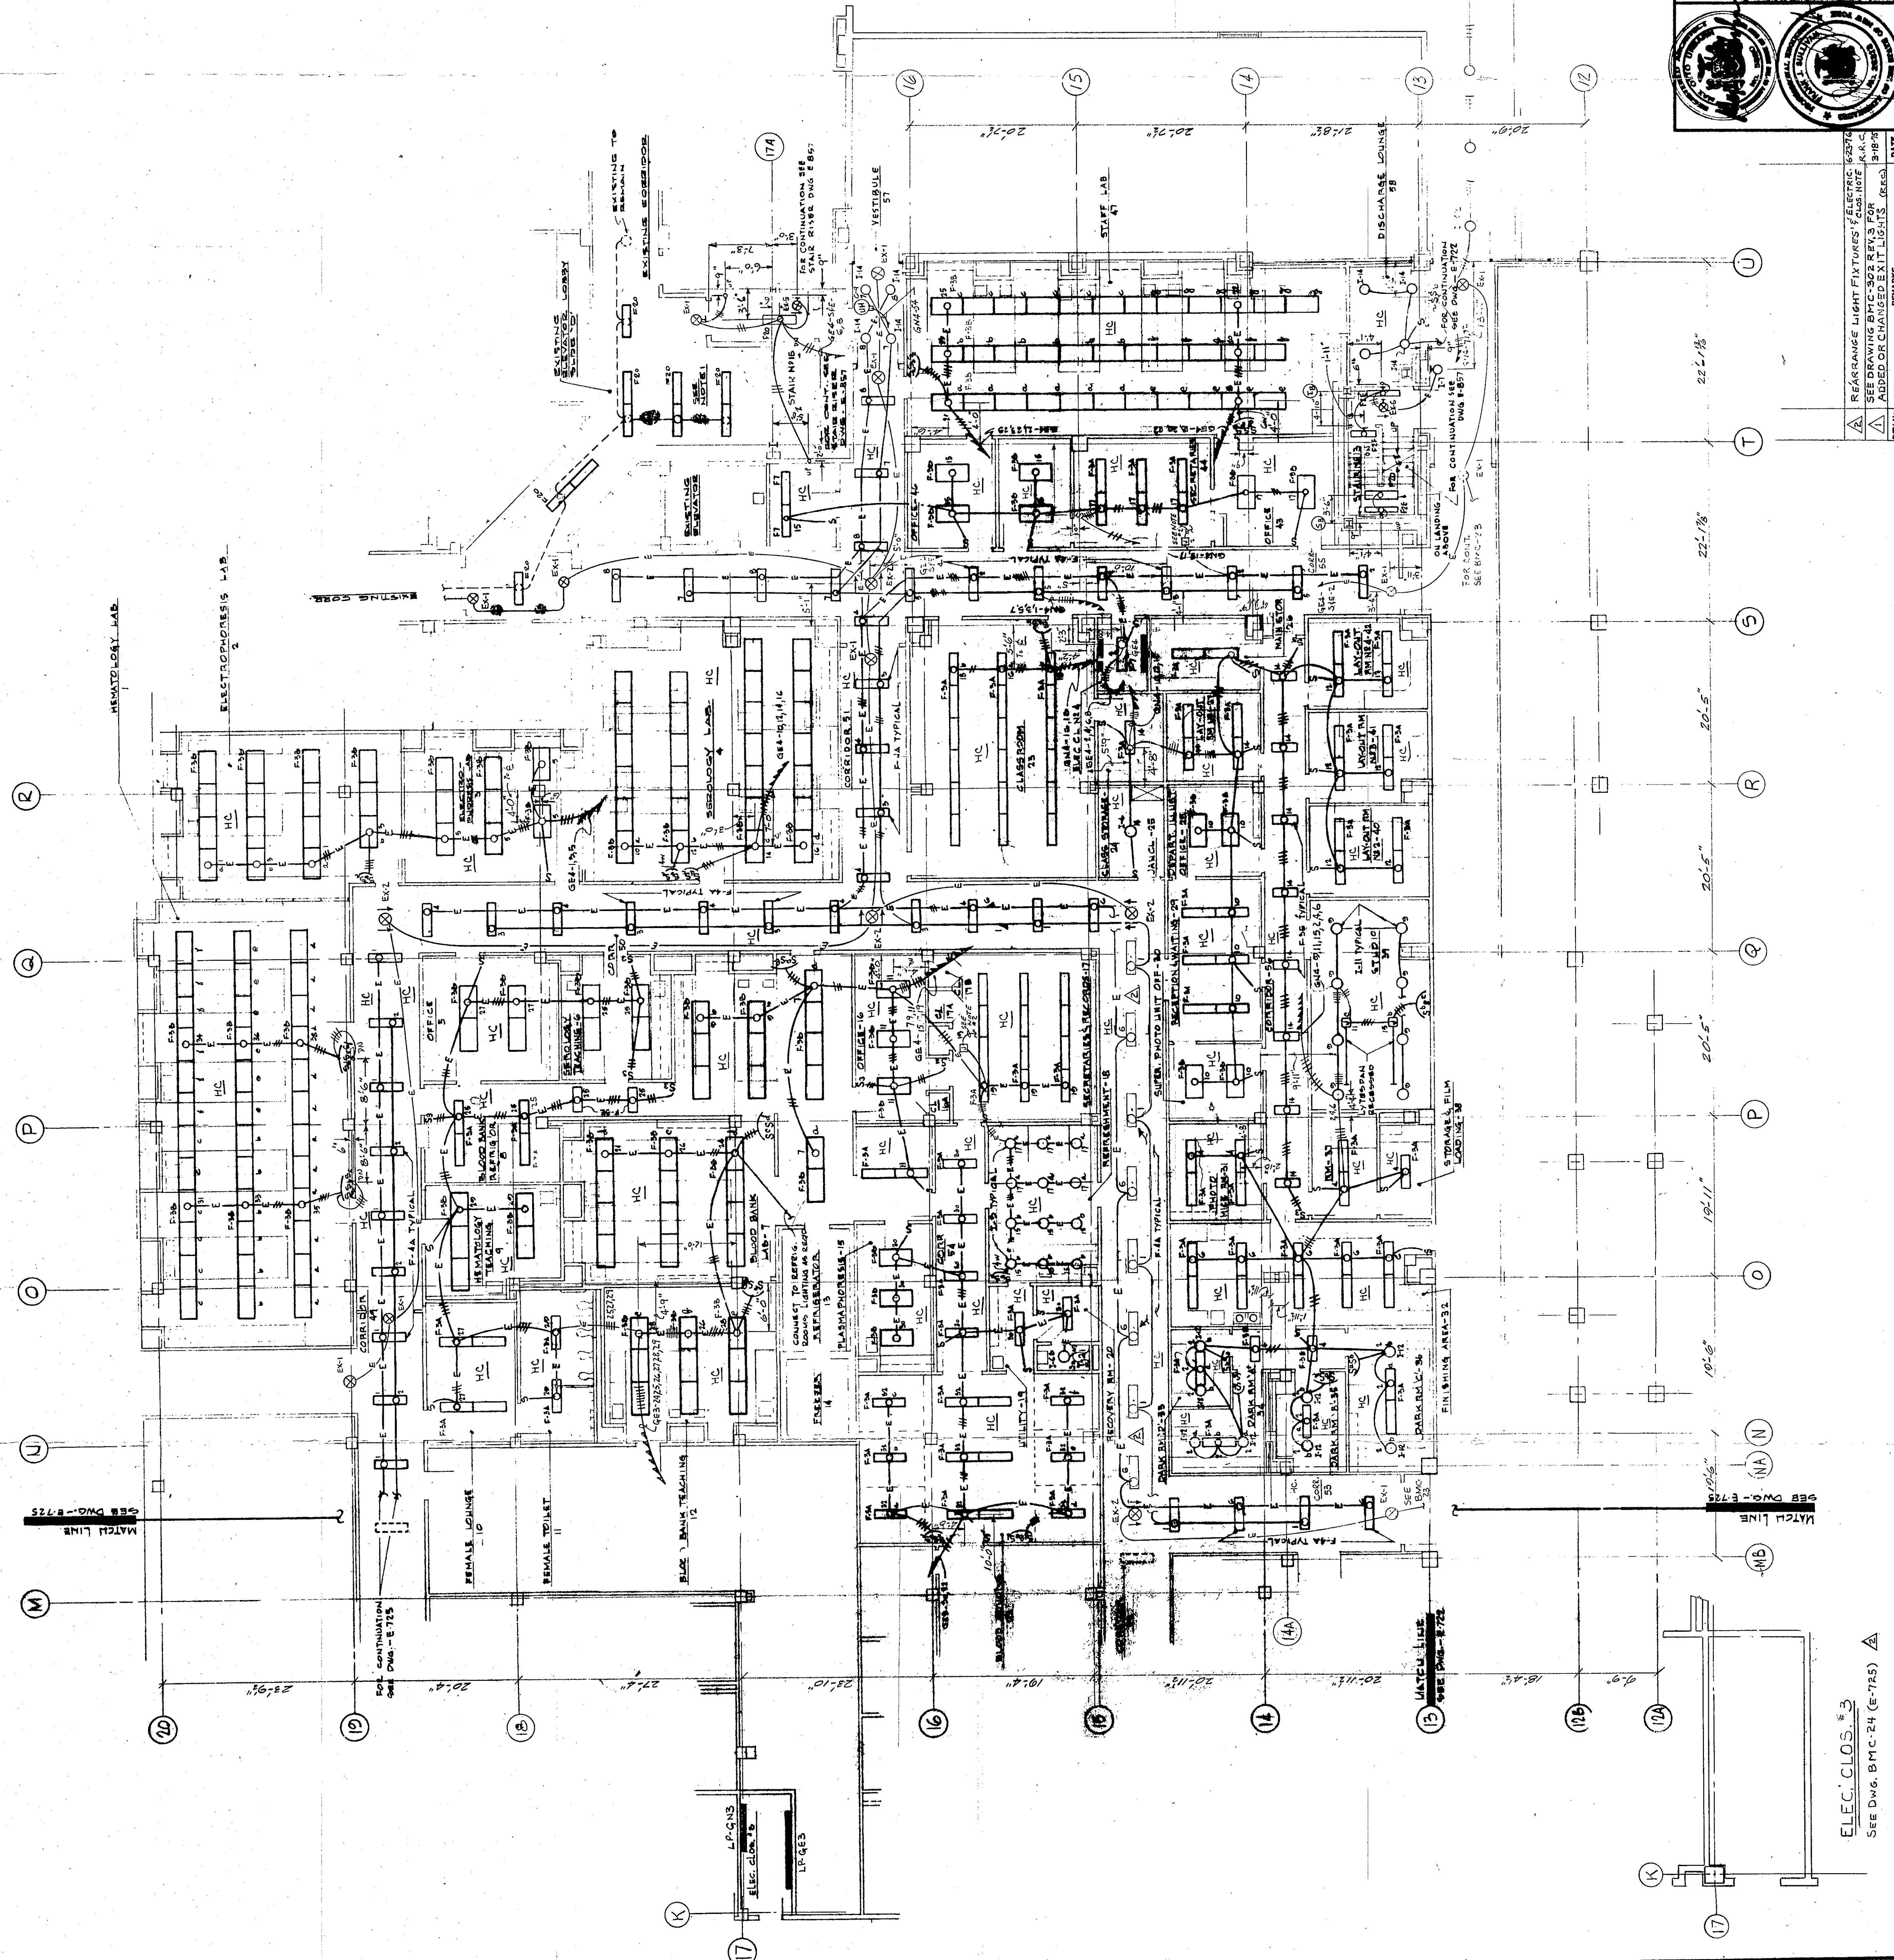

MEADOWBROOK HOSPITAL TOWN OF HEMPSTEAD NASSAU COUNTY	DWG NO. BMC-22
THE OFFICE OF MAX O. URBAN ARCHITECTS 442 FIFTH AVENUE NEW YORK, N.Y. 10019	DATE 6-23-76
FRIOLO - BLUM - YERBELEMAN ELECTRICAL ENGINEERS 100 WALL STREET NEW YORK, N.Y. 10038	DWG NO. E-728
DYNAMIC CARE BUILDING GROUND FLOOR LIGHTING	AREA F

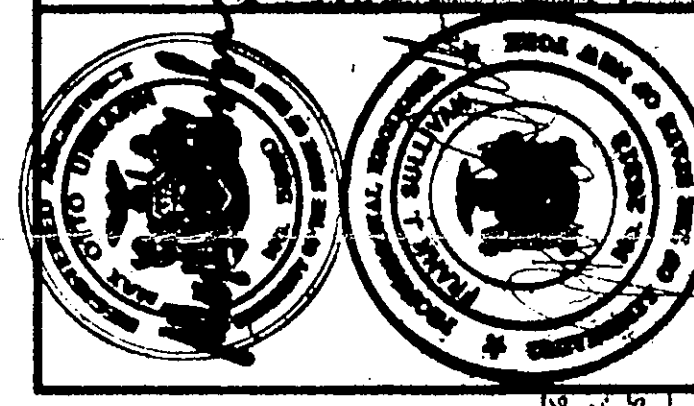

ELEC. CLOS. #3
SEE DWG. BMC-24 (E-725)

REARRANGE LIGHT FIXTURES, RELOCATE
SEE DRAWING BMC-302 REVS FOR
ADDED OR CHANGED EXISTING LIGHTS

REVISIONS

DATE

BY

DATE

BY

DATE

BY

DATE

BY

DATE

BY

DATE

BY

DATE

BY

DATE

BY

DATE

BY

DATE

BY

DATE

BY

DATE

BY

DATE

BY

DATE

BY

DATE

BY